



SGCWE100

WIRELESS CONVENTIONAL SYSTEM EXPANDER MODULE




928/01

GENERAL DESCRIPTION

The wireless conventional system expander module is a device permitting to add a wireless sub-system to a conventional fire security installation.

This device is connected directly to the conventional control panel's zone line and is actually part of it. This device allows wireless sounders silencing by being controlled by the control panel's sounder output line.

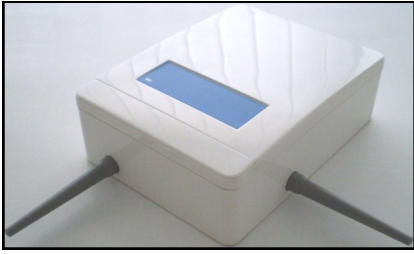

Picture 1 - Device overview

TECHNICAL SPECIFICATIONS

Communication range between expander and wireless devices	200 meters (in open space)
Operating frequency	868.15 MHz – 869.85 MHz
Modulation type	FSK
Operating frequency channels	7
Radiated power	5 dBm (3 mW)
Power supply voltage range	9 VDC - 30 VDC 12 VDC typical
Power supply lower fault threshold	9 VDC
Conventional zone line applied voltage	Same as device's power supply applied voltage
Sounder's line maximum voltage	27 VDC
Expander maximum current consumption	60 mA at 12 VDC (alarm)
Operating temperature range	-30 °C to +50 °C
Dimensions (without antennas)	120 mm x 160 mm x 51 mm
Weight	330 grams
Ingress protection rating	IP 51C
Required programming software	"Wirelex-Fire" revision 5.0 and successive

WHAT TO CHECK BEFORE INSTALLATION

Before installing the conventional system expander module check these following items:

- This device must be installed following your national and / or international codes of practice and standards: check them before performing the installation of this device.

- This device is compatible with most of the conventional control panels; check that the control panel is equipped with a power supply output through which you can, if desired, power the conventional system expander module; check if the panel is provided with a sounder output; check that control panel's specifications are suitable; for all this, consult your control panel's documentation or consult your control panel's supplier for more information.

DEVICE POSITIONING FOR RADIO COMMUNICATION PERFORMANCE AND STABILITY

The conventional expander module must have a good radio communication with its wireless system's child devices. In order to achieve this, before positioning it and installing it, apply scrupulously the following points:

- Avoid installing the module close to:

- equipment using large amounts of electrical current
- large metal objects, structures or metal ceiling structures
- fluorescent lighting fixings
- computers, their cabling and network cabling.

- If there are other wireless translators or wireless modules, keep a distance between them of at least 2 meters. In general every installed radio device (child devices included) must have a minimum distance of at least 2 meters from each other.

- It is recommended to install the conventional expander at a height from the floor of at least 2 - 2.5 meters.

- Install the conventional expander perfectly flat on the wall.

- The conventional expander must be installed perfectly straight on the wall; this means that the antenna under the device must be perpendicular to the floor and the antenna on the right of the device must be parallel to the floor.

- Environmental parameters (temperature, humidity and so on) must be in the ranges specified in the conventional expander's technical specifications, which can be found at the beginning of this manual; this point applies, obviously, to all other wireless devices.

- After having installed the conventional expander, make sure that its child devices (sensors, call points, etc.) are reached by a good, strong signal (refer to the single device's manuals) in their position of installation.


Radio transmission ranges for the conventional expander can be found in the technical specifications at the beginning of this manual.

- Use the personal computer's "Wirelex-fire" software for configuring and administering the system.


PLACEMENT AND FIXING

The conventional system expander module's lodgement box is designed with four 20 mm breakable, "knock-out" entry holes (two at the top and two on the upper side of the rear of the box), allowing sealed, cable gland fitted, cables to be connected to the device. To place and fix the module perform in sequence the following steps:

- Find a suitable location for the device's box.
- Prepare the cable openings on the box.
- Securely and adequately fix the device's box to the wall with adequate screws.
- Fit the cable's gland (or glands) into the "knocked out" device box's cable entry; check gland's IP rating: it must be equal or greater than the IP rating of the expander module: see the TECHNICAL SPECIFICATIONS table.
- Feed the cables into the box, giving them sufficient length for a secure connection.

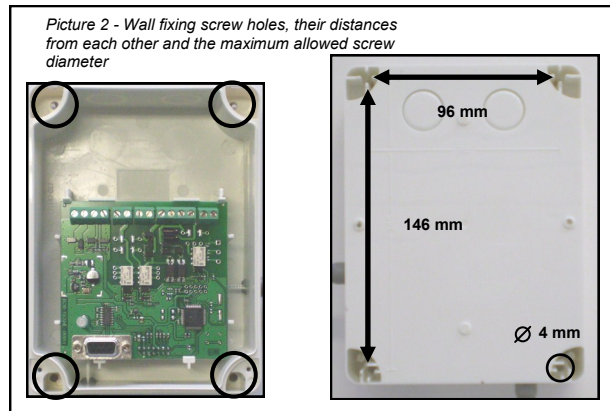

Picture 3 - Breakable holes for cable entry

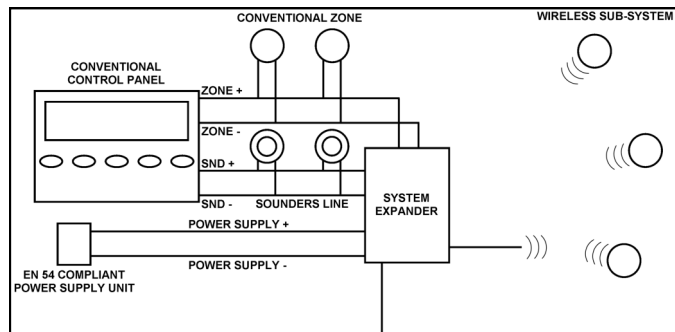

Picture 4 - An example of a conventional - wireless system

WIRING CONNECTIONS

The conventional system expander module's wiring phase of the installation has the following objectives:

- Connect the power supply cables (either from the control panel or from an independent source).

- Connect main and backup power supply monitoring inputs (optional).

- Connect the conventional zone line.

- Connect the control panel's sounder output (optional).

- Install the end of line (EOL) resistors required as specified in this manual; their values must be chosen according to the control panel's specification and literature.

WIRING WARNINGS

Three warnings about wiring:

- Perform any wiring operation with the power supply source and the control panel inactive.

- Electrostatic sensitive device: observe precautions when handling and making connections.

- Connections to the terminals are polarity sensitive, thus, please, check them by referring to the wiring instructions of this manual.

IMPORTANT NOTE

Check and apply the "ZONE ALARM EOL" and the "CHECKING THE POSITIONING OF THE ELECTRICAL BRIDGES" paragraphs before using the expander module.

DEVICE WIRING - POWER SUPPLY

The conventional system expander module must be power supplied either:

- directly by the control panel or
- from an external power source or
- from an external power source with a power backup unit.

Use the scheme at the right for connecting the power supply to the device.



This terminal wiring scheme is always applied.

If you want to use an external power source with a power backup unit, two additional module's terminal blocks come in use: "MAIN MONITORING" and "BACKUP MONITORING".

"MAIN MONITORING" is a terminal that supervises the main power supply of an external power supply unit.


"BACKUP MONITORING" is a terminal that supervises the backup power supply of an external power supply unit.

Let's have two examples of power supply units:

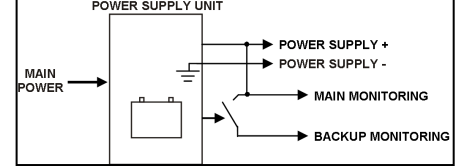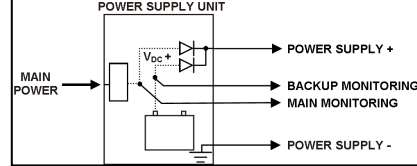

Picture 6 & 7 - Power supply unit example schemes


"MAIN MONITORING" and "BACKUP MONITORING" lines will be connected to the module as in the following scheme:

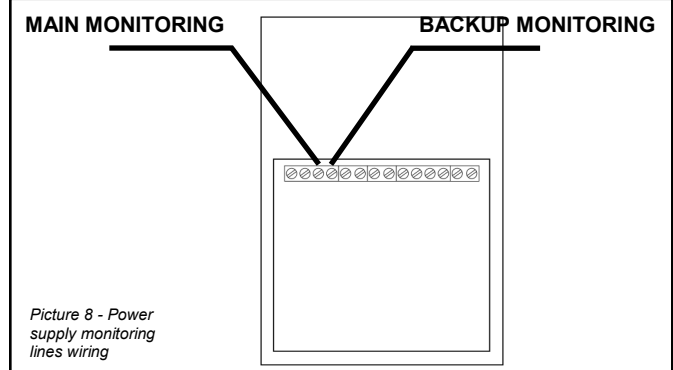

DEVICE WIRING - CONVENTIONAL ZONE LINE

In order to connect this device to the conventional zone line, two types of schemes can be used, depending on the positioning of the expander module on the line:

- the expander module is positioned at the beginning or in the middle of the zone line (conventional devices follow the device on the line or are positioned before and after it); therefore the zone line EOL resistor must be fitted externally as is normally done, but not into the device's terminal blocks:

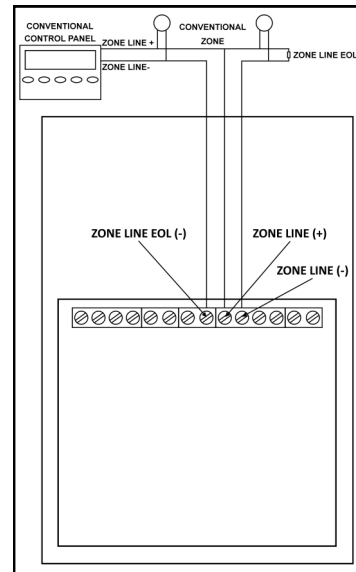


Picture 9 - Conventional line wiring (zone line EOL resistor outside of the device)

IMPORTANT: please note that with this wiring configuration, if a fault occurs on the wireless sub-system, all the remainder conventional line, subsequent the expander, is isolated from the system until the fault itself is handled and reset; this occurs unless each sensor on the conventional line is equipped with a Schottky diode and the control panel provides for their use.

Please refer to your applicable codes of practice and to your conventional control panel documentation.

- the expander module is positioned at the end of the zone line (all conventional devices are positioned before it); therefore the zone line EOL resistor must be fitted to the device's terminals and not externally as normally is done.

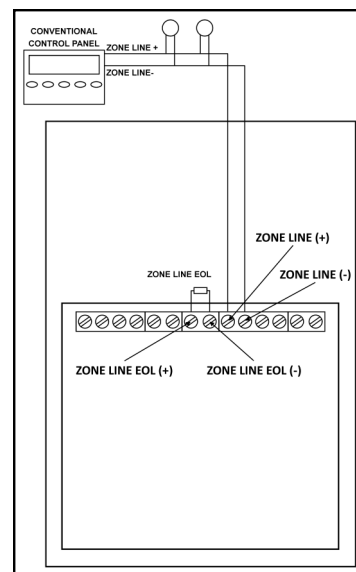

Picture 10 - Conventional line wiring (zone line EOL resistor inside of the device)

WARNINGS AND LIMITATIONS

Our devices use high quality electronic components and plastic materials that are highly resistant to environmental deterioration. However, after 10 years of continuous operation, it is advisable to replace the devices in order to minimize the risk of reduced performance caused by external factors. Ensure that this device is only used with compatible control panels. Detection systems must be checked, serviced and maintained on a regular basis to confirm correct operation.

Smoke sensors may respond differently to various kinds of smoke particles, thus application advice should be sought for special risks. Sensors cannot respond correctly if barriers exist between them and the fire location and may be affected by special environmental conditions. Refer to and follow national codes of practice and other internationally recognized fire engineering standards. Appropriate risk assessment should be carried out initially to determine correct design criteria and updated periodically.

WARRANTY

All devices are supplied with the benefit of a limited 3 year warranty relating to faulty materials or manufacturing defects, effective from the production date indicated on each product.

This warranty is invalidated by mechanical or electrical damage caused in the field by incorrect handling or usage. Product must be returned via your authorized supplier for repair or replacement together with full information on any problem identified.

Full details on our warranty and product return policy can be obtained upon request.



ARGUS SECURITY S.R.L.

11
0832-CPD-1689

EN 54-25:2008
Components using radio links

EN 54-18:2005
Fire detection and fire alarm systems. Input/output devices


SGCWE100

For further technical data see the latest revision of document TDS-SGCWE that can be obtained from your supplier or directly from the manufacturer.

DEVICE WIRING - CONTROL PANEL SOUNDER OUTPUT LINE

Conventional sounders are installed on the sounders line and the voltage level applied to their terminals by the control panel controls their functioning by activating or deactivating them (silencing).
 Wireless sounders are controlled in the same exact way through the wireless expander module; this means that this kind of radio outputs respond indirectly to the voltage level applied by the control panel to the sounders line positive and negative terminals of the expander module.
 In order to connect the module to the sounders line, two types of schemes can be used, depending on the positioning of the expander module on this line:


- the expander module is positioned at the beginning or in the middle of the sounders line (sounder devices follow the module on the line or are positioned before and after it); therefore the sounders line EOL resistor must be fitted externally as is normally done, but not into the device's terminal blocks:

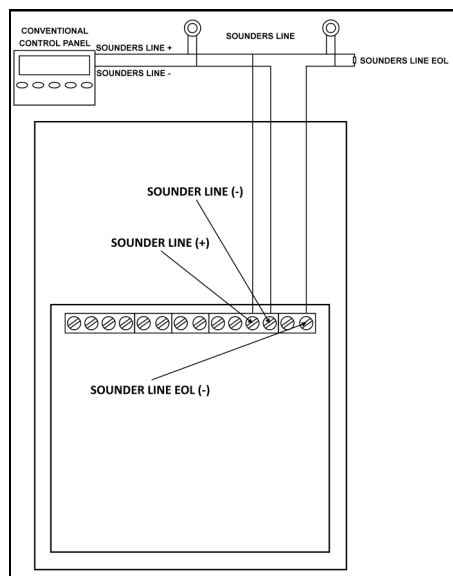

Picture 11 - Sounders line wiring (sounders line EOL resistor outside of the device)

IMPORTANT: please note that with this wiring configuration, if a fault occurs on the wireless sub-system, all the remainder sounder output line, subsequent the expander, is isolated from the system until the fault itself is handled and reset; this occurs unless each sounder on the sounder output line is equipped with a Schottky diode and the control panel provides for their use.
 Please refer to your applicable codes of practice and to your conventional control panel documentation.


- the expander module is positioned at the end of the sounders line (all sounders are positioned before it); therefore the sounders line EOL resistor must be fitted to the device's terminals and not externally as normally is done.

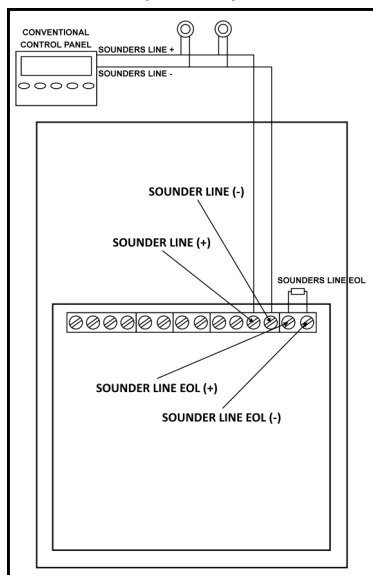

Picture 12 - Sounders line wiring (sounders line EOL resistor inside of the device)

ZONE ALARM EOL


The zone alarm end of line (EOL) resistor must ALWAYS be installed on the expander; to have its value refer to your control panel's literature.

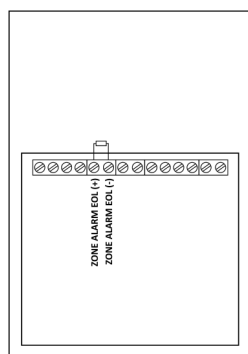

Picture 13 - Zone alarm EOL installation terminal blocks on the expander device

CHECKING THE POSITIONING OF THE ELECTRICAL BRIDGES

In order to function, the wireless expander module needs to have two electrical bridges fitted on the pins on its PCB in the way illustrated in the following picture:

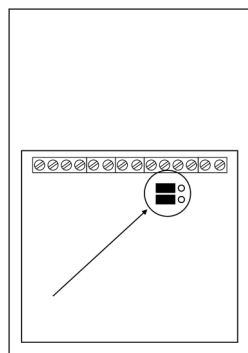

Picture 14 - Electrical bridges correct positioning

VISUAL LED INDICATOR

The conventional expander module is equipped with a three-colour LED (red, green and amber) that provides visual indication for power supply conditions; this indicator is positioned on the internal PCB of the device and it's light is visible through a slit on the device's cover.

The table 1 illustrates the possible LED visual signals and their meaning.

Device Status	Green LED	Red LED
Normal	Continuous glowing	-
Primary power supply fault	-	Continuous glowing
Backup power supply fault	Sequential green - red blinks	

Table 1

PROGRAMMING THE WIRELESS SUB-SYSTEM

The wireless sub-system is created and programmed through the use of a "Wirelex-Fire" program installed on a personal computer that is connected via RS232 serial port to the wireless conventional system expander module.

In order to gain additional information on the "Wirelex-Fire", please, consult the latest revision of the "Guide to wireless system installation" (code: APN-W0001) obtainable from your supplier or directly from the manufacturer.

TESTING THE WIRELESS CONVENTIONAL SYSTEM EXPANDER MODULE

Testing needs the fire security system to be wired, programmed and armed.

Trigger an alarm on the wireless sub-system: as a consequence the conventional control panel must set into alarm.

After the test reset the whole system from the control panel.

SEALING THE DEVICE WITH ITS COVER

After testing you can install the device's cover onto the module and, safely and securely, close it by using the screws provided.